


J:\AUTOCAD FILES\AUTOCAD MASTER DWGS\WORKING DWGS\Standard SPEC Dwg\Std-Dwg FOWD\Dwgs\Std-13-FireService Meter.dwg, 11/15/07 01:28:38pm, time

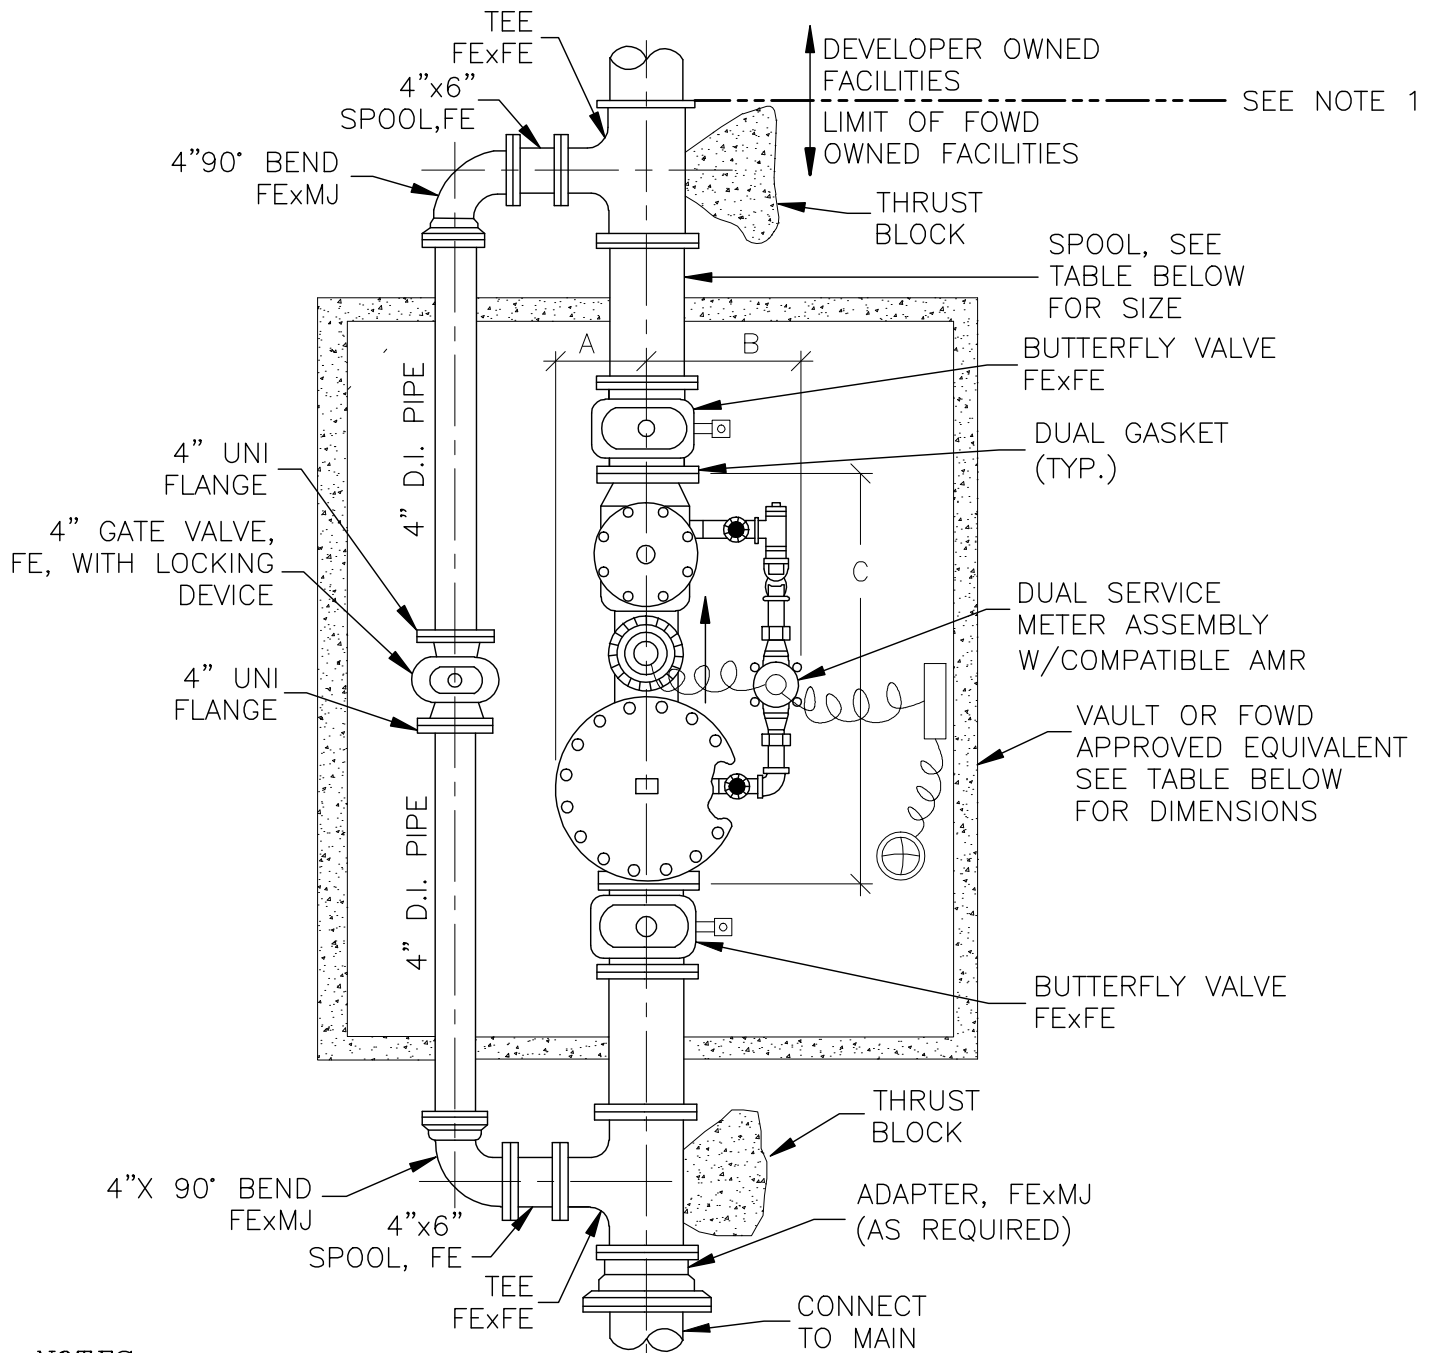


**NOTES:**

1. INSTALL BACKFLOW PREVENTION DEVICE PER STD DRAWING-12
2. VAULT SHALL HAVE TORSION OR SPRING ASSISTED LIDS

SIZE	METER DIMENSIONS			SPOOL SIZE	MINIMUM VAULT SIZE
	A	B	C		
4"	8"	15"	33"	4"x18"	4'x5'
6"	10 1/2"	19 1/2"	45"	6"x18"	5'x6'
8"	12 1/2"	21 3/4"	53"	8"x18"	5'x7'
10"	13 3/4"	22 1/2"	68"	10"x18"	5'x8'

**Fair Oaks Water District**

10317 FAIR OAKS BLVD, FAIR OAKS, CA 95628-7187  
 OFFICE (916) 967-5723, FAX (916) 967-0153  
 WEBSITE: WWW.FOWD.COM



**FAIR OAKS  
 WATER DISTRICT**

**DUAL PURPOSE DOMESTIC AND  
 FIRE SERVICE METER ASSEMBLY**

**Standard Drawing 13**

APPROVED:  
 M. NISENBOYM  
 DRAWN BY  
 T. EGGAR  
 DRAWING  
**STD-13**  
 REVISED  
 AUG 2007  
 SCALE  
 N/A

**Standard Specifications**