


J:\AUTOCAD FILES\AUTOCAD MASTER DWGS\WORKING DWGS\Standard SPEC Dwg\Std-Dwg FOWD\Dwgs\Std-11-FH-6in-wet.dwg, 11/15/07 12:51:58pm, time

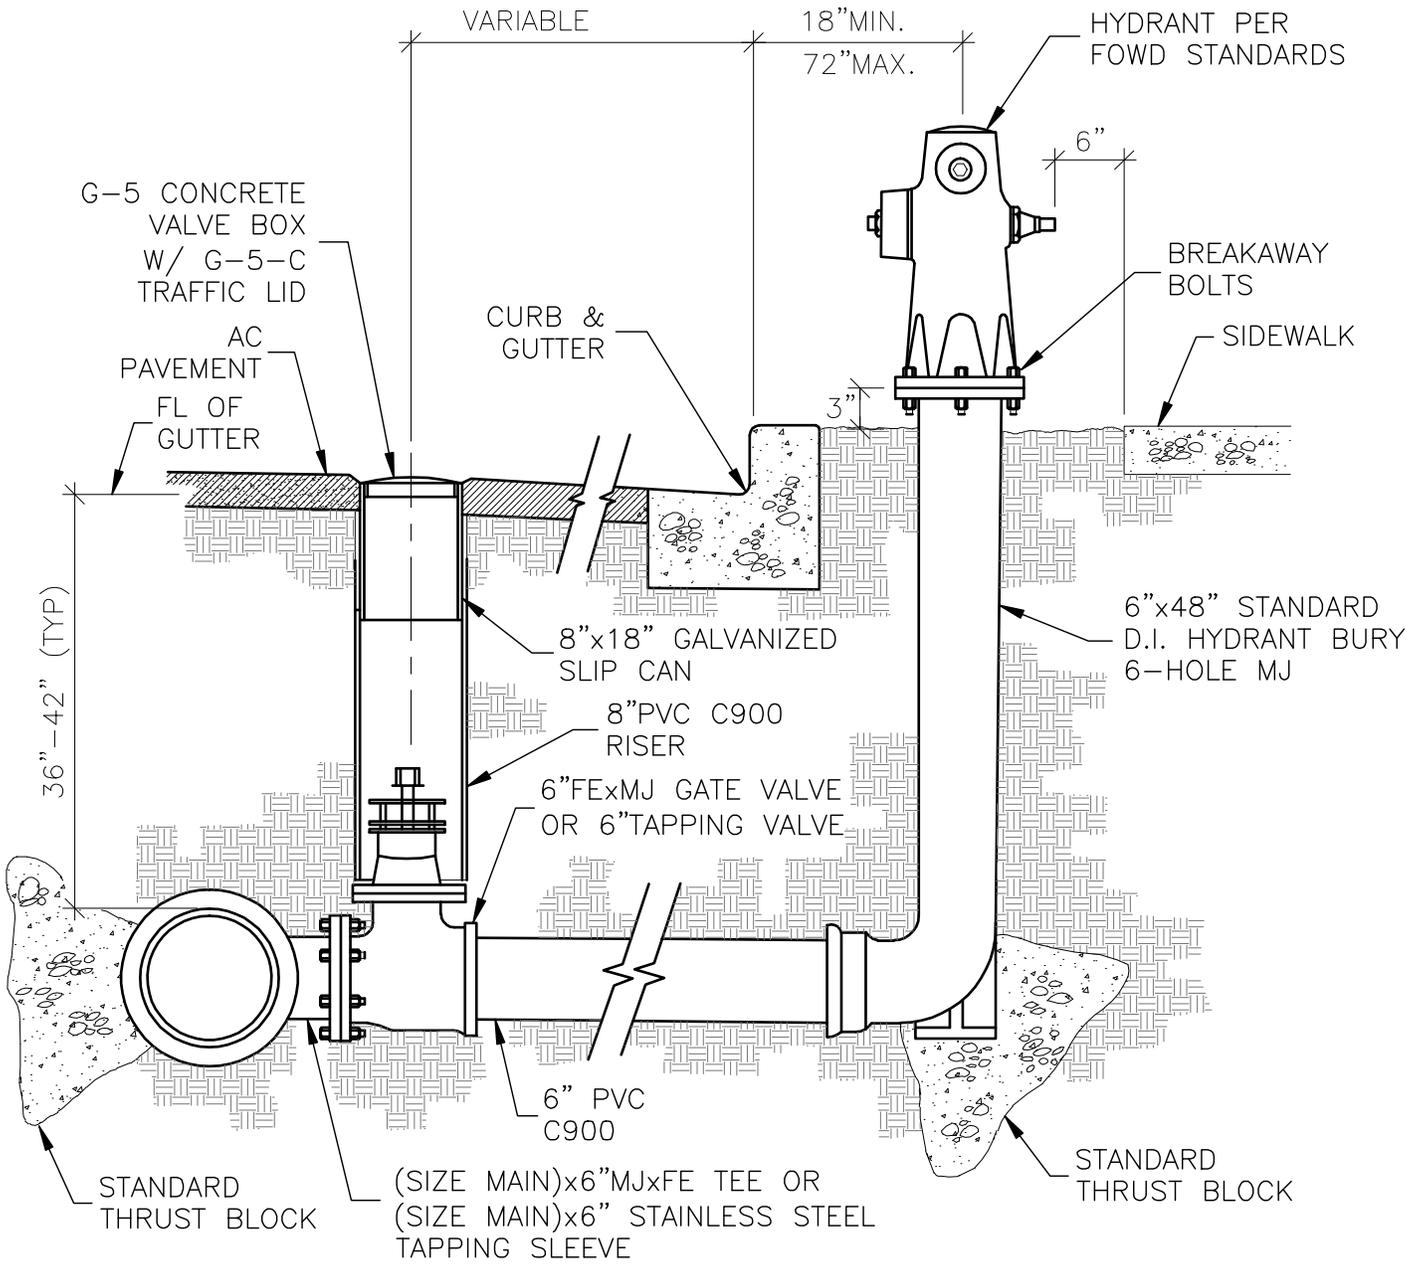

NOTES:

1. ON ROADS WITHOUT CURBS, FIRE HYDRANTS SHALL BE LOCATED WITHIN THE ROAD RIGHT OF WAY, ONE FOOT CLEAR FROM THE PROPERTY LINE UNLESS OTHERWISE INDICATED ON THE PLANS.
2. HYDRANT & RISER ARE TO BE PAINTED PER LOCAL FIRE DEPARTMENT REQUIREMENTS, CONTRACTOR TO SUPPLY PAINT AND PRIMER.
3. IF GATE CAN INSTALLED IN CONCRETE, USE FOWD APPROVED G-5 VALVE BOX OR EQUIVALENT.

Fair Oaks Water District
 10317 FAIR OAKS BLVD, FAIR OAKS, CA 95628-7187
 OFFICE (916) 967-5723, FAX (916) 967-0153
 WEBSITE: WWW.FOWD.COM



**6" WET BARREL
 FIRE HYDRANT**

APPROVED:
 M. NISENBOYM
 DRAWN BY
 T. EGGAR
 DRAWING
STD-11
 REVISED
 AUG 2007
 SCALE
 N/A

Standard Specifications

**FAIR OAKS
 WATER DISTRICT**

Standard Drawing 11