


J:\AUTOCAD FILES\AUTOCAD MASTER DWGS\WORKING DWGS\Standard SPEC DWGS\Std-14-CompoundMeter-ByPass.dwg, 11/15/07 01:57:07pm, time

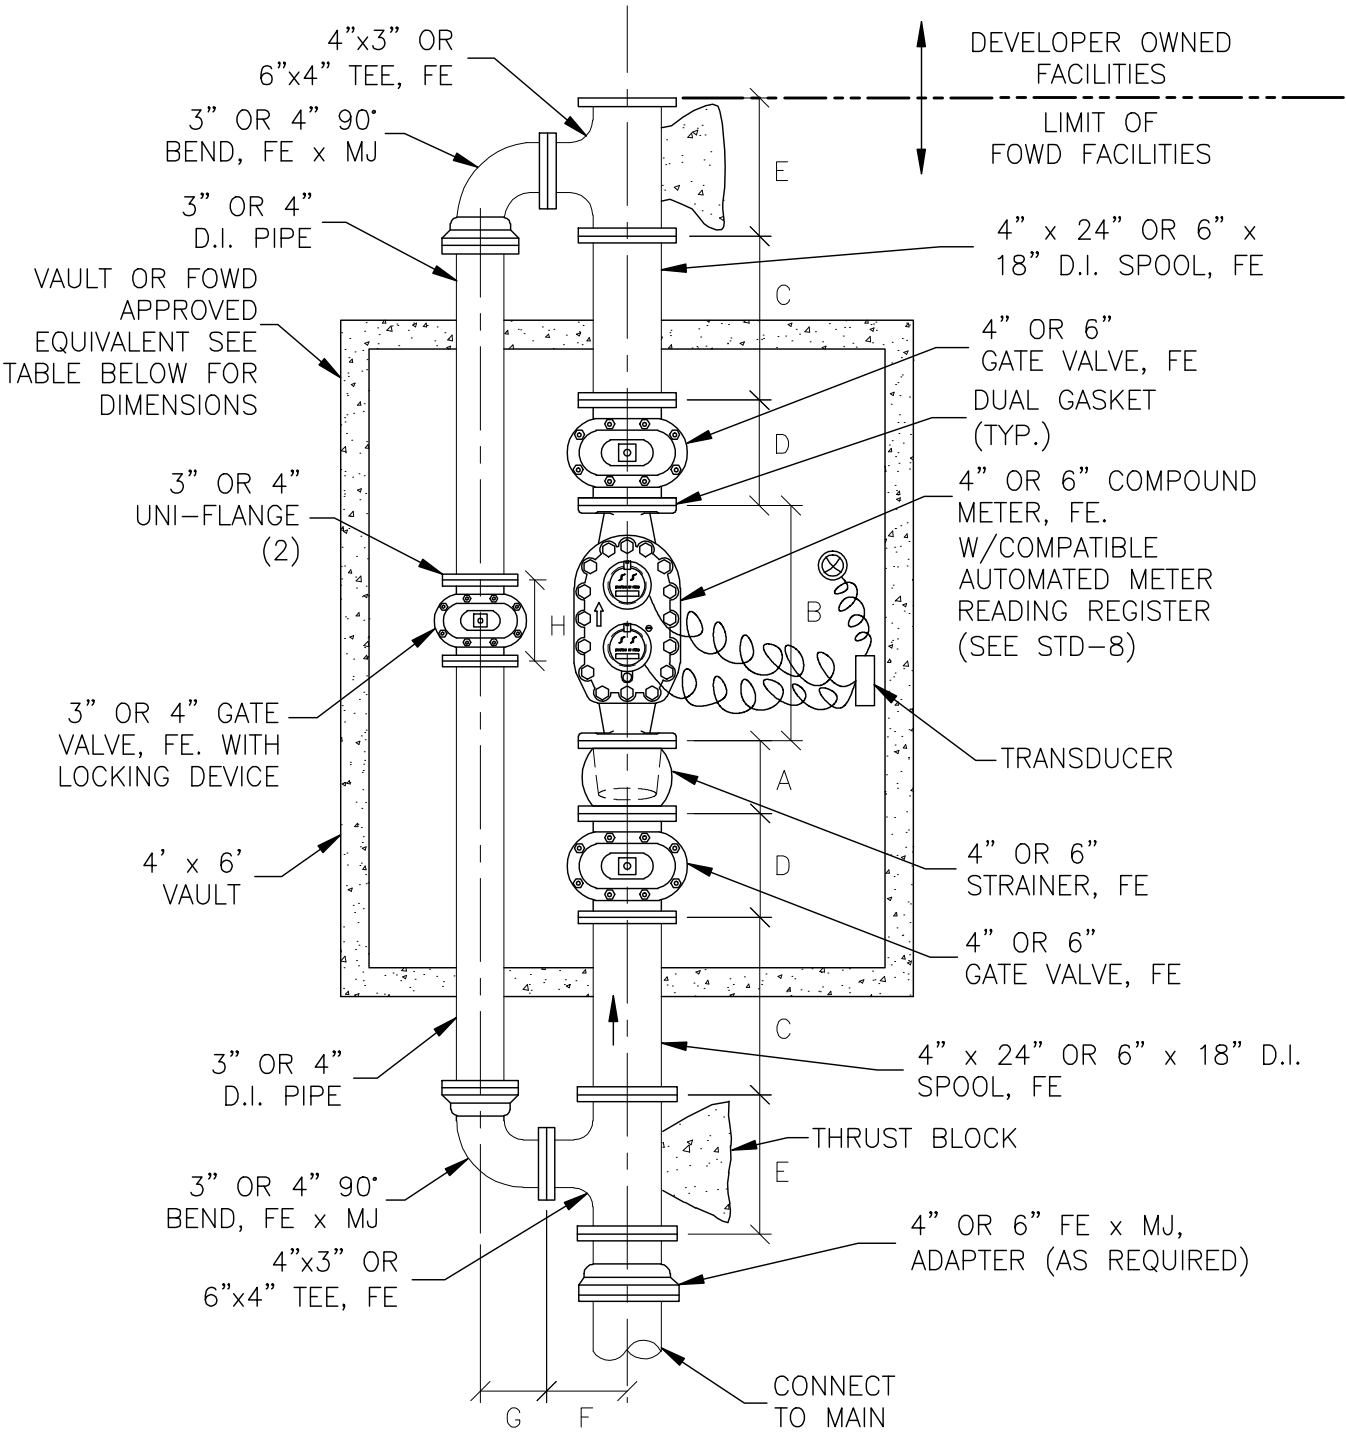

NOTE:
 VAULT SHALL HAVE TORSION OR SPRING ASSISTED LIDS.

METER SIZE	A	B	C	D	E	F	G	H
4"	7 1/2"	20"	24"	9"	9"	6 1/2"	5 1/2"	8"
6"	9"	24"	18"	10 1/2"	16"	8"	6 1/2"	9"

Fair Oaks Water District
 10317 FAIR OAKS BLVD, FAIR OAKS, CA 95628-7187
 OFFICE (916) 967-5723, FAX (916) 967-0153
 WEBSITE: WWW.FOWD.COM



4" OR 6" COMPOUND METER WITH BY-PASS

APPROVED:
 M. NISENBOYM
 DRAWN BY
 T. EGGAR
 DRAWING
STD-14
 REVISED
 AUG 2007
 SCALE
 N/A

Standard Specifications

FAIR OAKS WATER DISTRICT

Standard Drawing 14