



NOTES


1. WIRE TO BE CONTINUOUS BETWEEN VALVE BOXES.
2. LOCATING WIRE TO BE LAID LOOSELY OVER TOP OF PIPE AND TAPED EVERY 5' (MINIMUM)
3. A CONTINUITY TEST SHALL BE PERFORMED BY CONTRACTOR AT TIME OF FINAL ACCEPTANCE AND WITNESSED BY FOWD AUTHORIZED REPRESENTATIVE

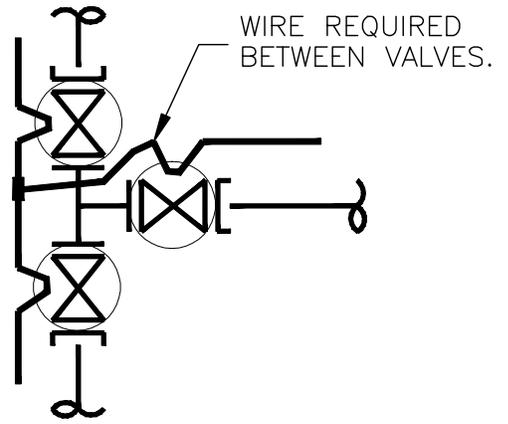

PLAN

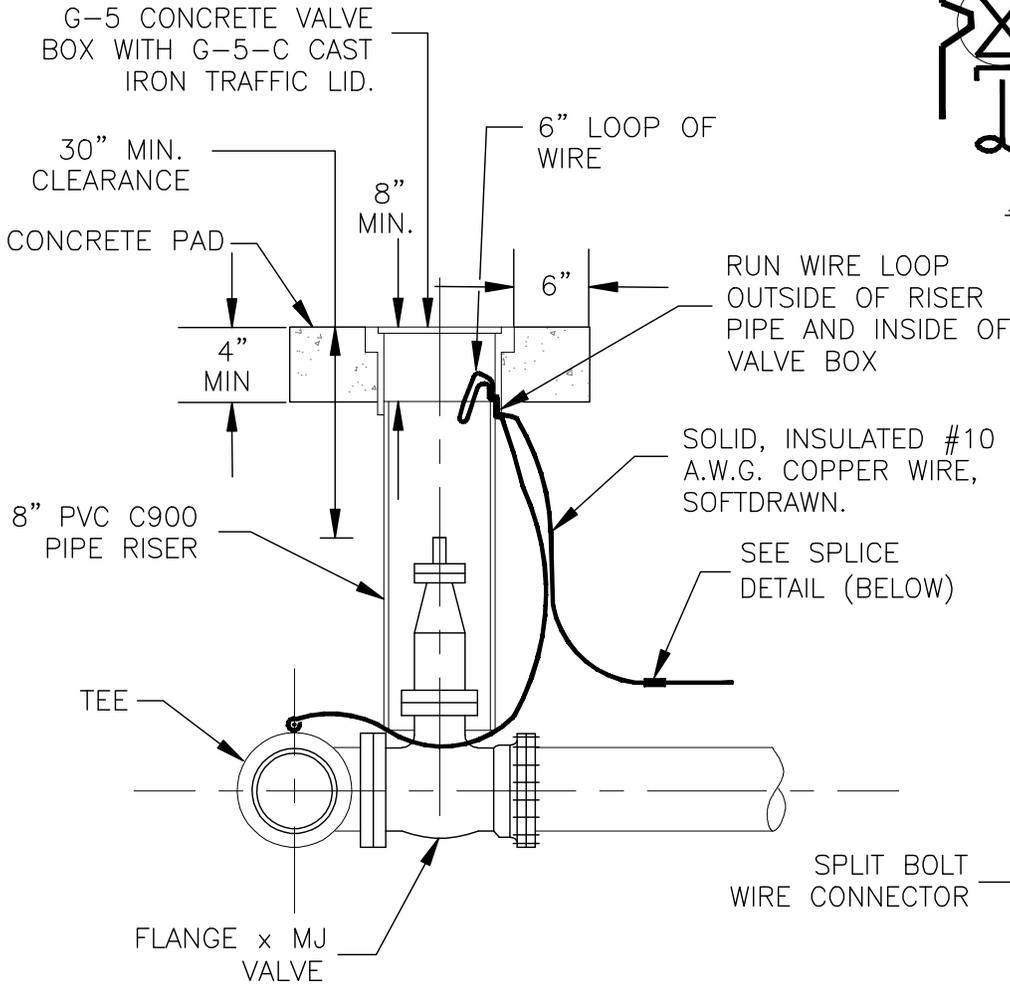

**ELEVATION
VALVE INSTALLATION**

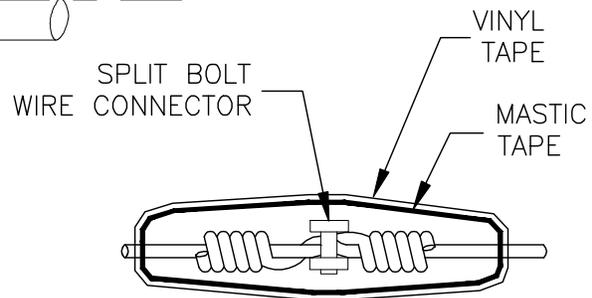


SPlice DETAIL

REMOVE INSULATION AT SPlice & WRAP SPlice WITH 3M TAPE OR OTHER APPROVED MATERIAL OR METHOD

J:\AUTOCAD FILES\AUTOCAD MASTER DWGS\WORKING DWGS\Standard SPEC Dwg\Std-5-Locating Wire.dwg, 11/15/07 09:49:45am, time

Fair Oaks Water District
 10317 FAIR OAKS BLVD, FAIR OAKS, CA 95628-7187
 OFFICE (916) 967-5723, FAX (916) 967-0153
 WEBSITE: WWW.FOWD.COM



**FAIR OAKS
WATER DISTRICT**

**VALVE AND LOCATING WIRE
INSTALLATION**

Standard Drawing 5

APPROVED:
M. NISENBOYM
 DRAWN BY
T. EGGAR
 DRAWING
STD-5
 REVISED
AUG 2007
 SCALE
N/A

Standard Specifications